


**FIG. 43**

**FVIR  
Water  
Heater**

Shutoffs & controls must be readily accessible & clearly visible.

Strapping & flex connectors in seismic areas

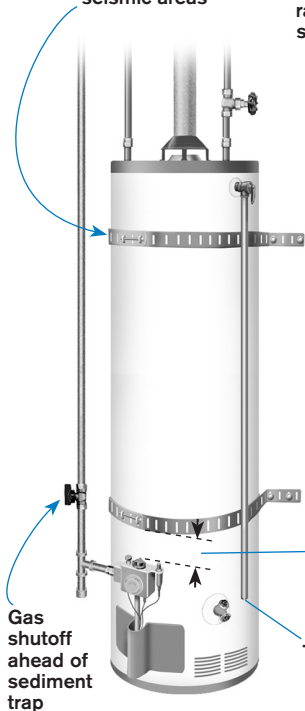

Gas shutoff ahead of sediment trap

Platform to raise ignition source 18 in. min. above floor unless WH is FVIR



Strap 4 in. min. above gas valve

Terminate to approved location max. 6 in. IRC, 6-24 in. UPC above floor or ground

**FIG. 44**

**Electric Water Heater**



No threads in end